


No - 1253
OFFICE OF THE INSPECTOR FIRE BRIGADE
CAMPBELL-BAY, GREAT NICOBAR
Nicobar District

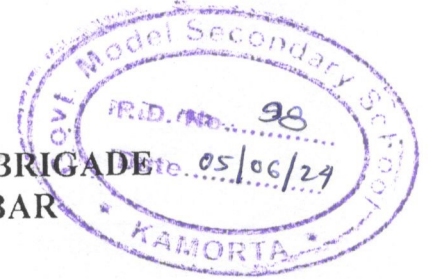

Campbell-Bay , Dated 03rd June 2024.

To,

The Principal (I/C)
Govt. Model Secondary School,
Kamorta.

Sub:- Fire Safety Audit for issuance of Fire Safety Certificate - Requirement of Fire Safety & Fire Protection- Prevention measures at school under mandatory safety precaution to be observed as per DGCD, MHA vide letter no VIII-11011/6/2004-DGCD(F), dated 30/07/2004- reg

Ref: Letter no F.NO 1-12/HM/GMSSK/NC/2024-25/993, dated 03/06/2024.

Sir,

Please refer on the subject cited above . Gist of the status of existing fire safety arrangements inspected by Fire Brigade Official from fire safety point of view and requirement of additional Fire Safety measures at Govt. Model Secondary School, Kamorta as per NBC Part IV 'Fire and Life safety' are furnished below under mandatory safety precaution to be observed as per DGCD, MHA vide letter no VIII-11011/6/2004-DGCD(F), dated 30/07/2004, for issuance of FCC to school -

A. FIRE PREVENTION AND FIRE PROTECTION ARRANGEMENTS -				
Sl No	Name of Fire Extinguishers	Qty.		Recommended
		Exist	Status	
1.	CO2 (4.5Kg)	03	OK	-
2.	DCP (4Kg)	06	OK	-
3.	WATER-CO2(9ltr)	03	OK	-
4.	Fire Buckets with Stand	02	OK	04 nos

Remarks -

- All Equipment should be safeguard from direct sunlight and rain.
- Fire buckets to be procured Confirming to IS: 2546 and Shall have round bottom with bottom handle having 09 ltrs. Capacity .
- HPT (Hydraulic Pressure Test) should be done in every 03 years upto the life span of 10 years from date of manufacture for Water, Foam ,Dry Powder and 05 year for CO2 *Extinguishers*. Register should be maintained.
- Equipment Certificate for Test and Warranty' are necessary.
- Fire Instruction Card/Register ' inviting details information about Fire Fighting Equipments, Staff Trained, location of water source, Assemble point etc. to be maintained

Received
m/m/s
05/06/24

Attested
K. Anil Kumar
VICE PRINCIPAL
GMSS KAMORTA